

FIG. 1

FIG. 1A

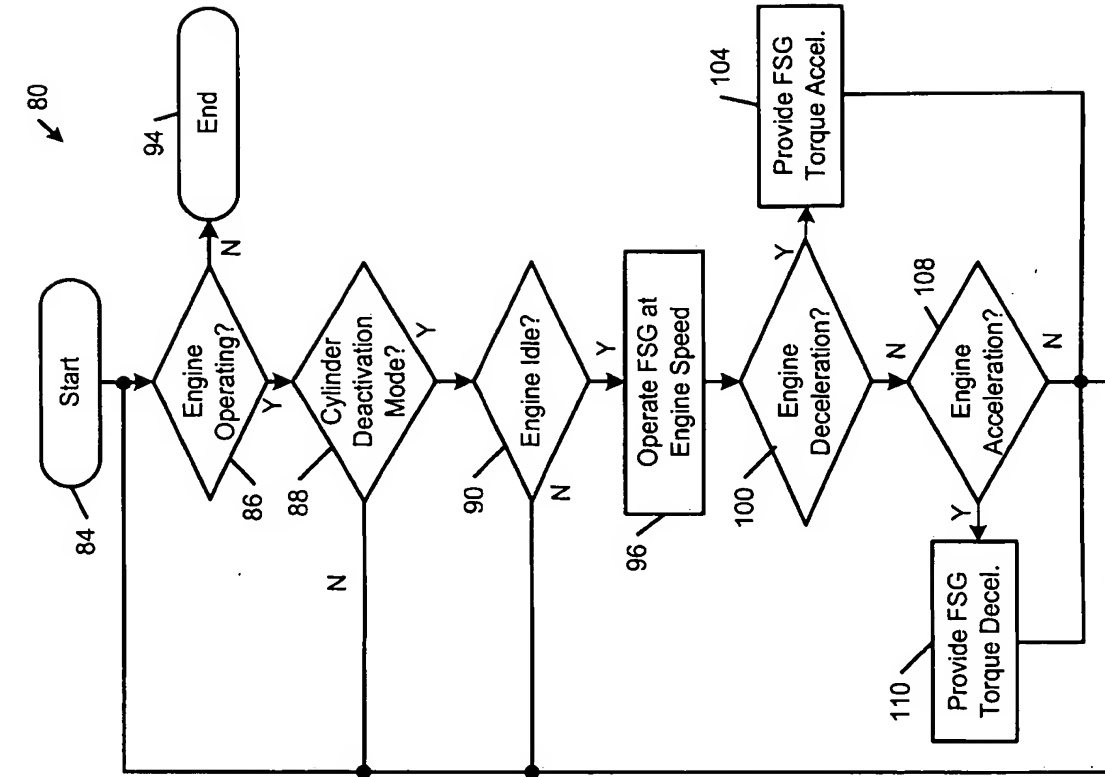


FIG. 2

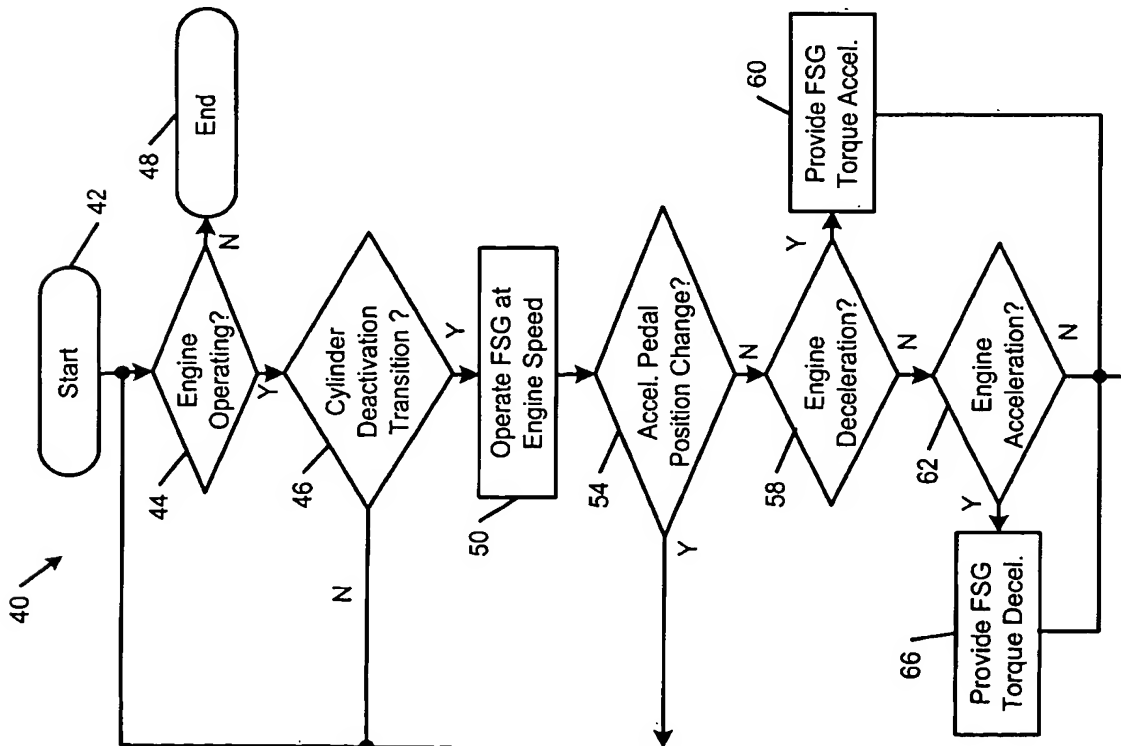


FIG. 3


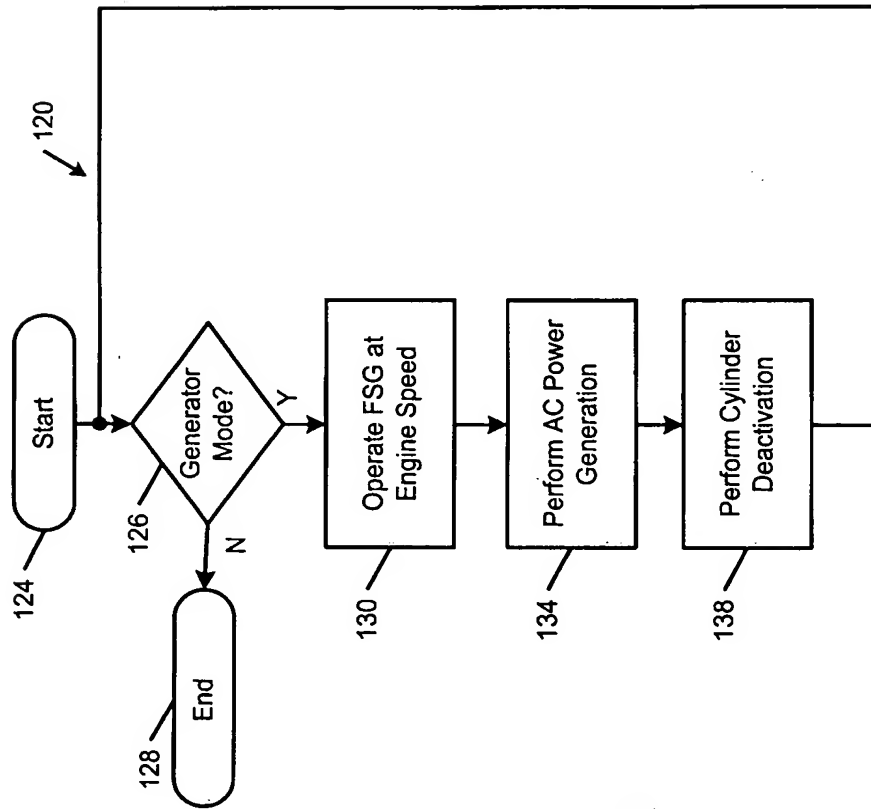


FIG. 4

4/5

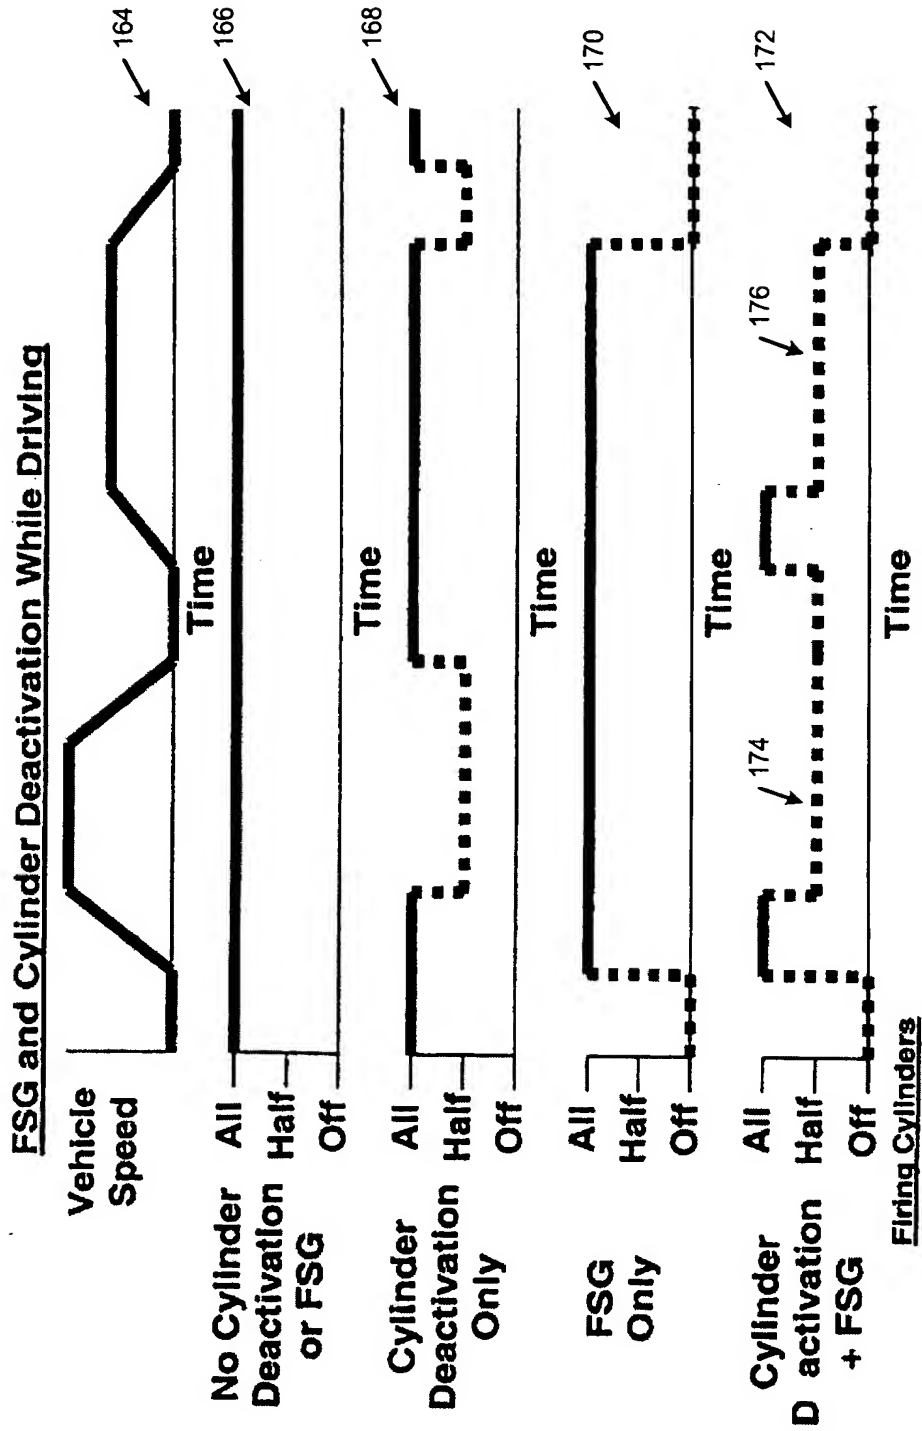

FSG and Cylinder Deactivation While Serving as Stationary Generator

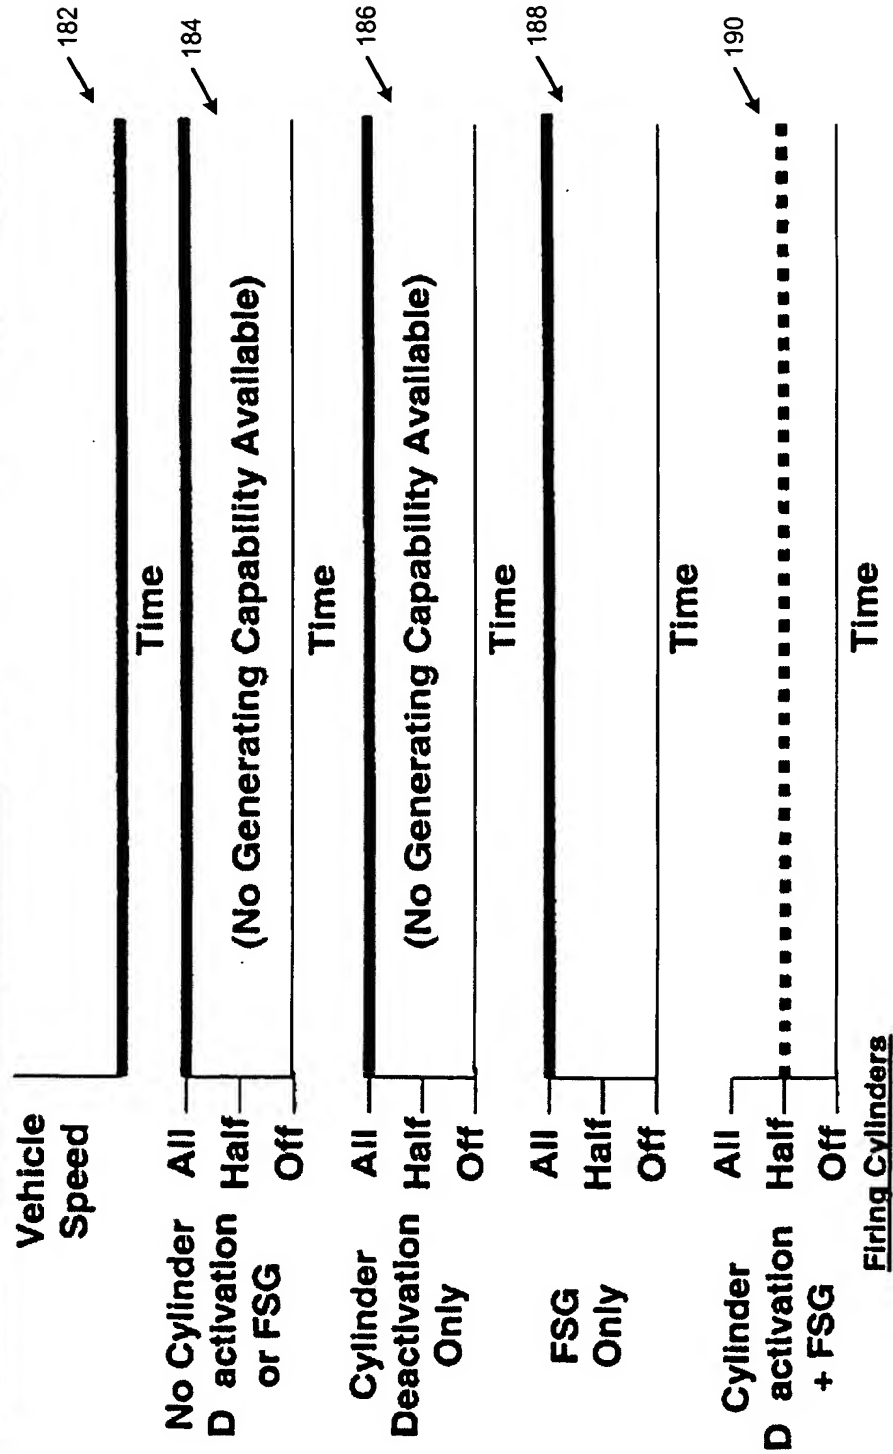


FIG. 6